

S-15	Keywords	Y3	equipment or facility	Z3	natural gas	S4	FEMS
						D	Construction

NIPPON STEEL ENGINEERING CO., LTD.

## Top Combustion Hot Blast Stove

### Features

A hot-blast stove is a facility to supply hot air to a blast furnace continuously. In the combustion (heat accumulation) phase, heat energy in hot exhaust gas from a burner is accumulated in checker bricks and, in the ventilation phase, a large quantity of air is blown through the checker bricks to raise the temperature of the air. The hot-blast stove of Nippon Steel Engineering (NSE) has the following characteristics.

- ◆ Achievement of high efficiency combustion
  - ⇒ Achievement of high efficiency combustion even in the operation only with blast furnace gas (BFG) (Mono-fuel BFG combustion)
- ◆ Achievement of ventilation of hot air
- ◆ Heat radiation from the stove body smaller than conventional stoves
  - ⇒ It has a smaller radiation surface area than conventional ones because of its smaller size.
- ◆ Applicable to blast furnaces with volumes over 5,000 m<sup>3</sup>
  - ⇒ NSE's design technology makes it possible to use the hot blast stove with large blast furnaces with volumes over 5,000 m<sup>3</sup>.
- ◆ Low construction costs
  - ⇒ Because there are no complex burner bricks or partition walls and only a small volume of bricks, the hot blast stove is inexpensive.
- ◆ Short manufacturing cycle
  - ⇒ The furnace manufacturing cycle is short since the lack of complex burner bricks means the furnace construction difficulty is low.
- ◆ Space saving
  - ⇒ No need for a combustion chamber: The improved heat accumulation allows its installation in an area smaller than the area required for installation of the conventional hot-blast stoves.
- ◆ Stove service life of 40 years
  - ⇒ The hot blast stove makes use of NSE's refractory technology with a track record of long service lives.
- ◆ Complete elimination of stress corrosion cracking
  - ⇒ Stress corrosion cracking (SCC) is completely eliminated with Nippon Steel Corporation's SCC-resistant steel and NSE's fabrication technology.

### Basic Concept or Summary

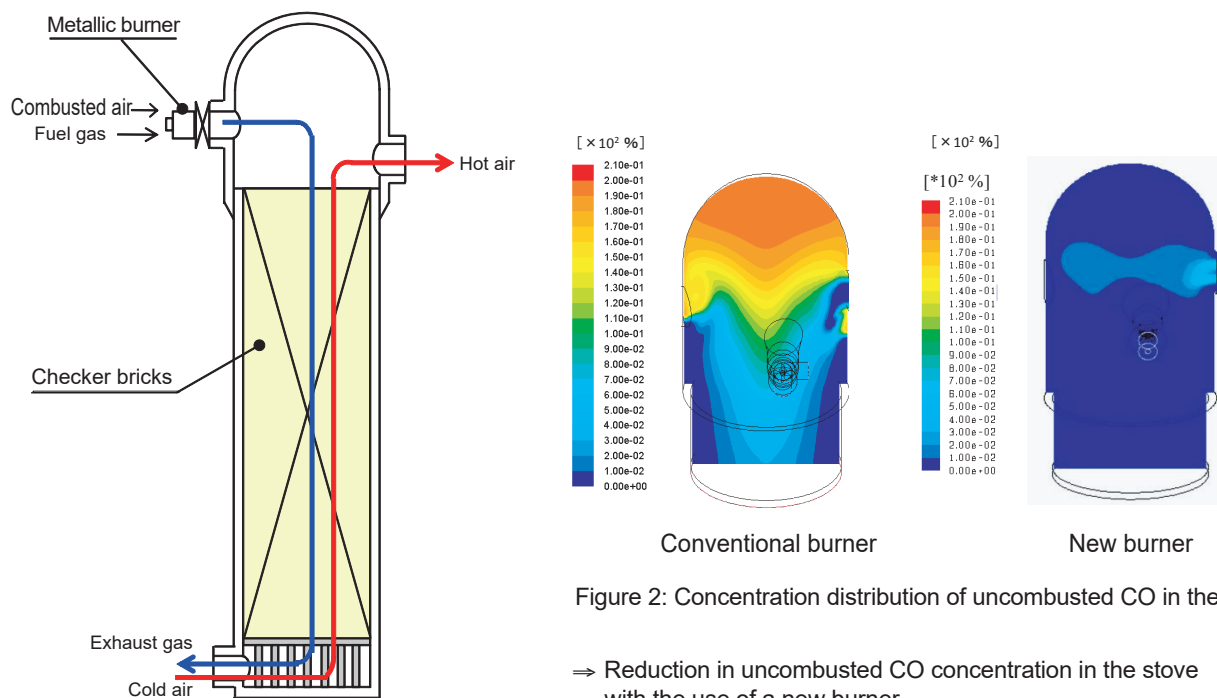


Figure 1 NSE furnace top combustion-type hot-blast stove

Figure 2: Concentration distribution of uncombusted CO in the stove

- ⇒ Reduction in uncombusted CO concentration in the stove with the use of a new burner

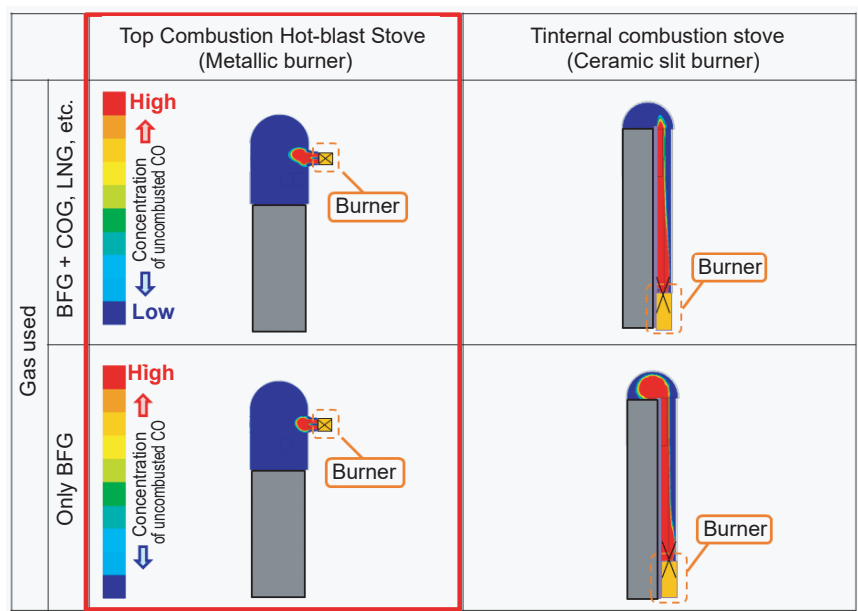


Figure 3: Comparison of the performance of burners in the mono-fuel BFG combustion (diagram of the concentration distribution of uncombusted CO)

⇒ The concentration of uncombusted CO above the upper surface of checker bricks is reduced to 1/10 of the concentration in the conventional internal combustion stove during the mono-fuel BFG combustion.

#### Effects or Remarks

- ◆ High combustion performance which reduces the concentration of uncombusted CO in the stove
- ◆ Potential for the reduction of energy consumption in a hot-blast stove for a 5,000 m<sup>3</sup> blast furnace by 1 - 2 %
- ◆ The concentration of uncombusted CO in the space above the checker bricks can be reduced to approx. 1/10 of the concentration in the conventional internal combustion hot-blast stoves.
- ◆ Consumption of energy required for the mono-fuel BFG combustion can be reduced by 2 - 3 %.
- ◆ High heat-transfer efficiency
- ◆ The hot-blast stove provides high heat-transfer efficiency because gases flow at a constant velocity along the entire checker brick profile.
- ◆ Reduction in the ratio of reducing materials in a blast furnace with hot air ventilation
- ◆ Reduction of 10 kg/ton-pig in the coke ratio by raising the ventilation air temperature in a 5,000 m<sup>3</sup> blast furnace by 100 °C
- ◆ The energy loss through heat radiation from the stove body has been reduced by approx. 30 % compared with the conventional hot-blast stoves.

#### Installation in Practice or Schedule

**Domestic** Nippon Steel Corporation Kyushu Works,  
JFE Steel Corporation West Japan Works (two installations)

**Overseas**

**Contact:** **NIPPON STEEL ENGINEERING CO., LTD.,**  
Plant & Machinery Sector  
Osaki Center Building, 1-5-1 Osaki, Shinagawa-Ku, Tokyo 141-8604 Japan  
Phone: +81-3-6665-2000 Fax: +81-3-6665-4847